




Load Flow Study for sample 11kV Feeder using Rabbit ACSR conductor (peak load)

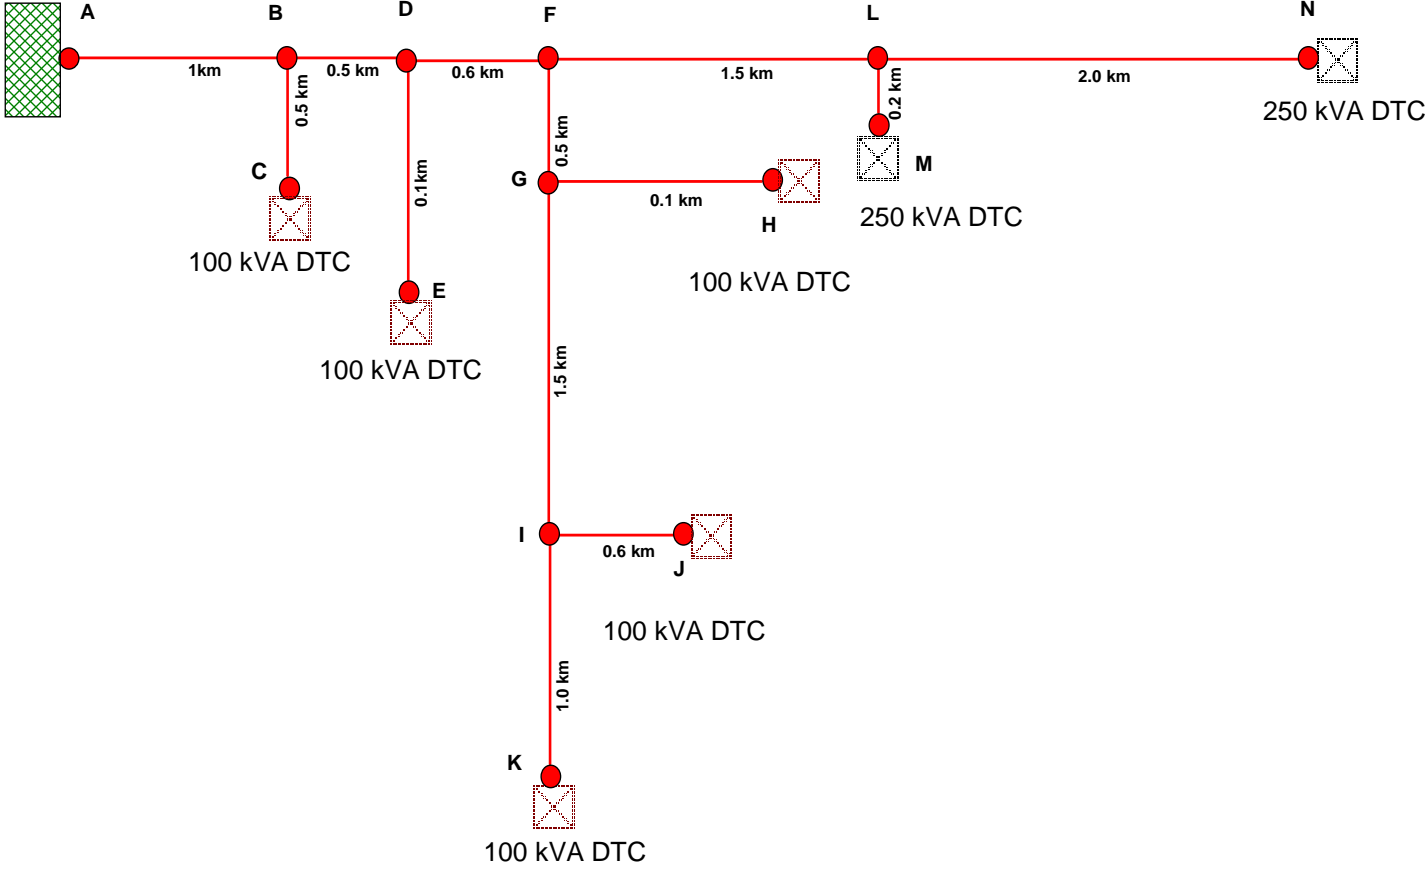

Scale



					Load Flow Study (peak load of 40A) For sample 11kV Feeder using Rabbit ACSR conductor	 Karnataka Electricity Regulatory Commission 6th & 7th Floor, Mahalaxmi Chambers, No. 9/2, M.G.Road, Bangalore-560 001
			R0			
APPROVED	REVIEWED	CHECKED	REV.	DATE		