



Load Flow Study for sample 11/0.415kV, 100kVA DTC using Rabbit ACSR conductor (for a peak load of 130A)

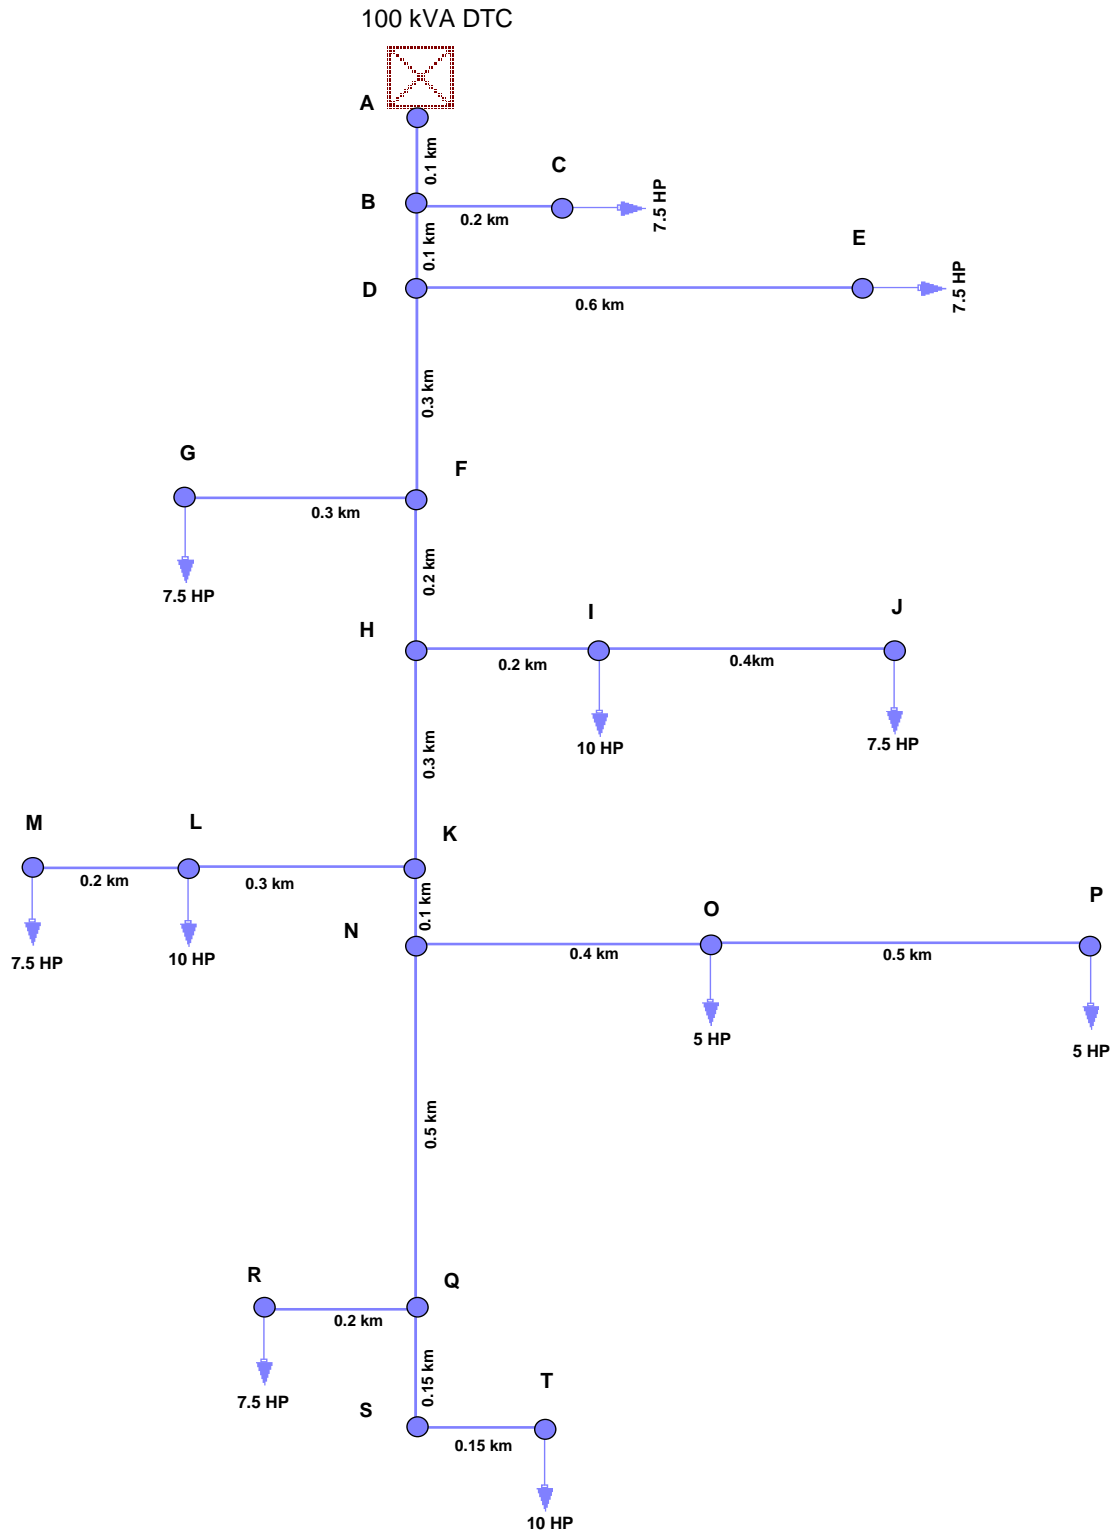

					Load Flow Study for sample 11/0.415kV, 100kVA DTC using Rabbit ACSR conductor	Karnataka Electricity Regulatory Commission  6th & 7th Floor, Mahalaxmi Chambers, No. 9/2, M.G.Road, Bangalore-560 001
			R0			
APPROVED	REVIEWED	CHECKED	REV.	DATE		